# How Direct Coupling Succeeds

*Paul Savage*
*Nextek Power Systems, Inc.*

## ABSTRACT

Nextek has substantially improved the commercial efficiency of all forms of distributed generation (DG), but especially solar photovoltaic (PV) systems, by the invention of a multi-source power module. One path in the module allows for the Direct Coupling® of PV to a direct-current (DC) load, eliminating the inversion to alternating current (AC) that is required in standard solar PV systems. Because PV is a relatively inherently low-yielding power source, ridding these systems of conversion losses make a large measurable difference in the system output. If the load requires more power than the distributed resource, other sources such as the grid or stored electricity, are combined with the DC to service the load. In this way, the threshold losses of inversion are avoided, and the contribution of the DG is a greater percentage of the total power delivered. Consumers therefore realize a dramatic acceleration of the payback of PV-powered building applications.

The power module outputs highly regulated DC by prioritizing its three inputs, 1) DC from a distributed generation source such as PV, 2) AC from the utility grid, and 3) optional battery storage. Precise metering, monitoring and control can also be performed at the module.

## THE TEST

As shown in Figure 1, this new interface for power acts like a router in a computer network by efficiently delivering system resources where they are needed. While PV directly connected to fluorescent lighting was used in this demonstration, the Direct Coupled® system is highly versatile and modular. Storage is easily integrated for uninterruptibility and demand-shaping; and other DC sources such as wind turbines or fuel cells are suitable candidates for inputs.

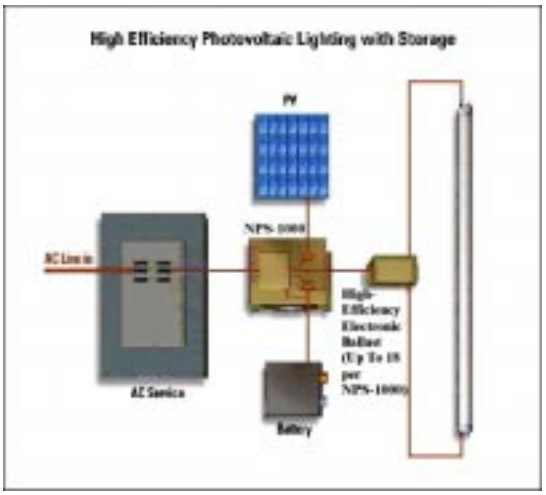


**Figure 1. A Direct-Coupled® Power Module Forms the Basis of a Highly Efficient Modular System.**

Two identical sets of solar arrays and electric loads were installed side-by-side. One array was connected with a high quality inverter and the other was connected with Nextek's Direct Coupling® technology. Both solar PV systems were carefully monitored by making measurements using accurately calibrated true-power meters to read both instantaneous and integrated (accumulated) Watt-hours. The objective was to measure the amount of effective solar PV array energy reaching the loads through the two systems under the same solar irradiation conditions. A series of tests over nine days were performed so that a variety of weather conditions could be taken into consideration, shown in Figure 2.

Solar PV systems using Direct Coupling® technology deliver several benefits visible in the results. For the inverter-based system, the threshold loss is the largest factor, and will dominate other variables - especially in smaller systems. In the 900-Watt arrays tested, the power electronics that burden the inverter are a phantom load of 50 to 70 Watts. Integrated over time, these losses are devastating to production, as the data show. This shortfall, however, isn't the only loss in certain systems. Where a peak power-tracking device is used, it also consumes power – perhaps less than it contributes in an AC delivery paradigm - but it adds in any event a greater level of complexity that increases the initial capital expenditure and therefore postpones the return. The Direct Coupling®

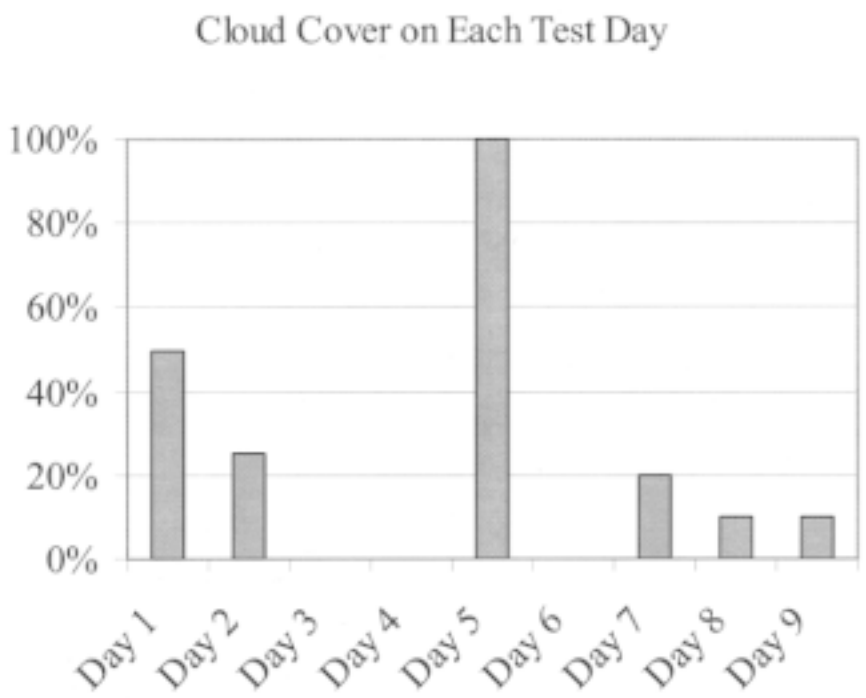


**Figure 2. Cloud Cover During Test Period.**

system and method is quasi-peak tracking as it passively collects at near the peak power point of 54-volt arrays, as it is designed to take the electricity at a point very near or at the optimal operating voltage of the load. These features allow for superior collection of the sun's energy. As shown in Figure 3, the Direct Coupled® system delivered on average 93% more kilowatt-hours to the load than did the inverter-based system.

Looking at one day in detail can further illuminate these results and give graphic clarity to the source of the disparity. Figure 4 shows the constant load on top, and how the competing systems vie to displace the AC kilowatt-hours needed to supplement the solar power.

The jagged path of the inverter system never intersects the smoother profile of the Direct Coupled® system. The difference in contour reflects the different paradigm of the algorithm. The inverter employs a peak power-tracking device that actively looks to "find" the peak power point of the available energy so as to optimize its collection. The Direct Coupling® module, on the other hand, achieves this goal by design, not

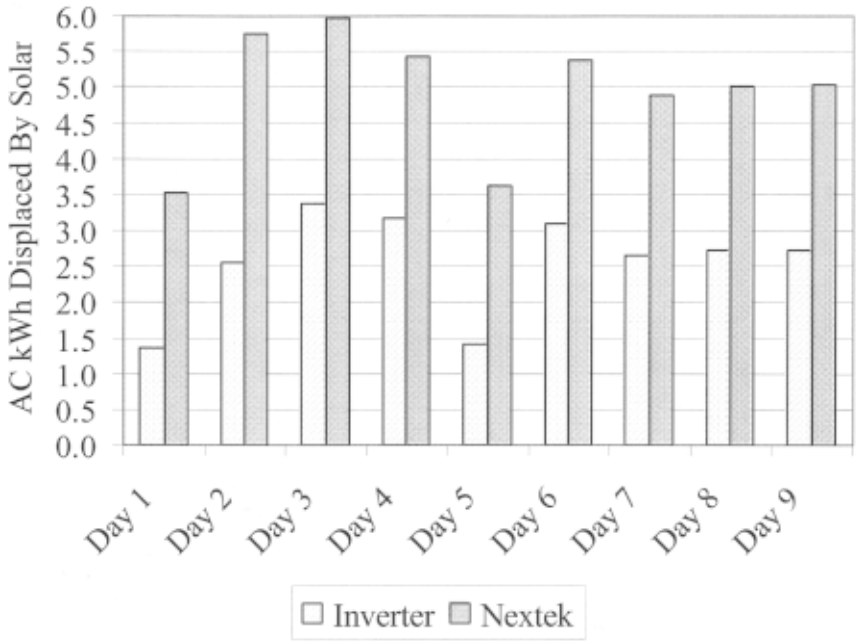


**Figure 3. Daily Total AC kWh Displaced.**

through an external fix. By feeding the solar power collected at the panel voltage to an interface using that operating voltage as its own, the system handles the electricity less, thereby lowering the loss. This average difference between these two lines is the difference in total system losses. The area below the lines is the integrated representation of the AC power needed to supplement the DC to service the load. Here the DC paradigm again shows its inherent economy. In such a system the incentive is to undersize the solar, closely matching the peak load requirement with the actual peak output. This lowers the largest driver in the economic equation for most buyers: the up-front cost of the PV itself. It also provides a highly geared incentive to begin to consider what on the customer's side of the power equation has always been the least popular exercise: analyzing the power requirements of the appliances we buy.

The Direct Coupling® paradigm has a greater impact over conventional practice that must be explored further. Because the drain of the inverter is relatively constant, its effect on the total system output is greater as a percentage when the harvest is low, i.e. when the sun is most obscured by the cloud deck or nearest dawn or dusk. It is telling that on

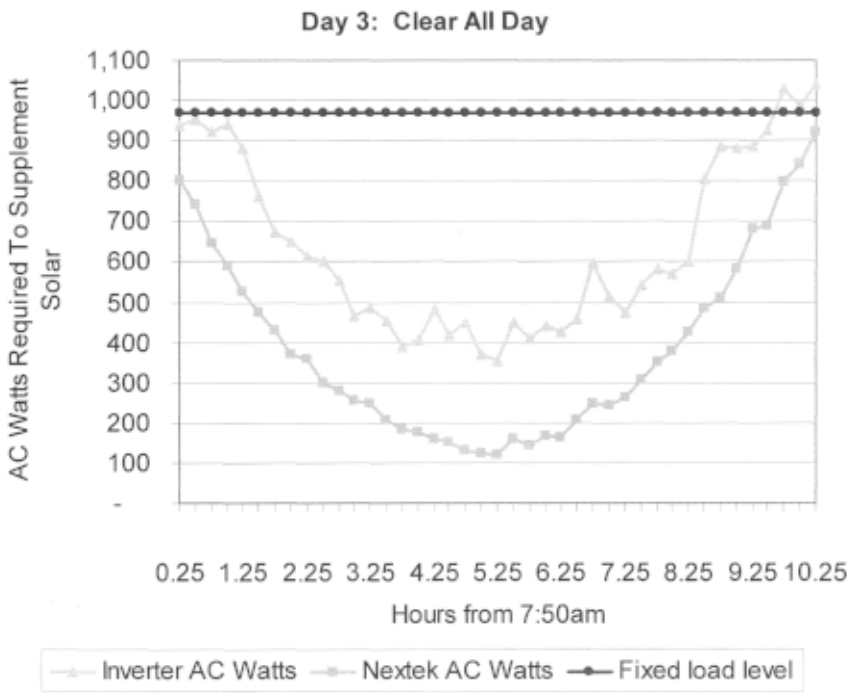


**Figure 4. Comparison of AC Watts Required To Supplement Solar On Clear Day.**

the worst day for solar collection — when the sun was least available — the Direct Coupling® system delivered 155% more kWh than the competing inverter-based system (see Figure 5 below). The conclusion, therefore, is that the poorer the solar availability, the more critical the decision to employ Direct Coupling®, for economic reasons.

## THE LOAD

In this test, electronically ballasted florescent lights (T-8s) were the load. Most commercial and industrial building lighting loads are intrinsically DC by virtue of the use of electronic ballast. The ballasts operate in three stages where the first is rectification, which delivers the DC it makes from the AC delivered to it; the second is a high-frequency oscillator which provides its product to the third stage: the lamp driver itself. Conventional ballasts were replaced in this test by DC-ready ballasts,

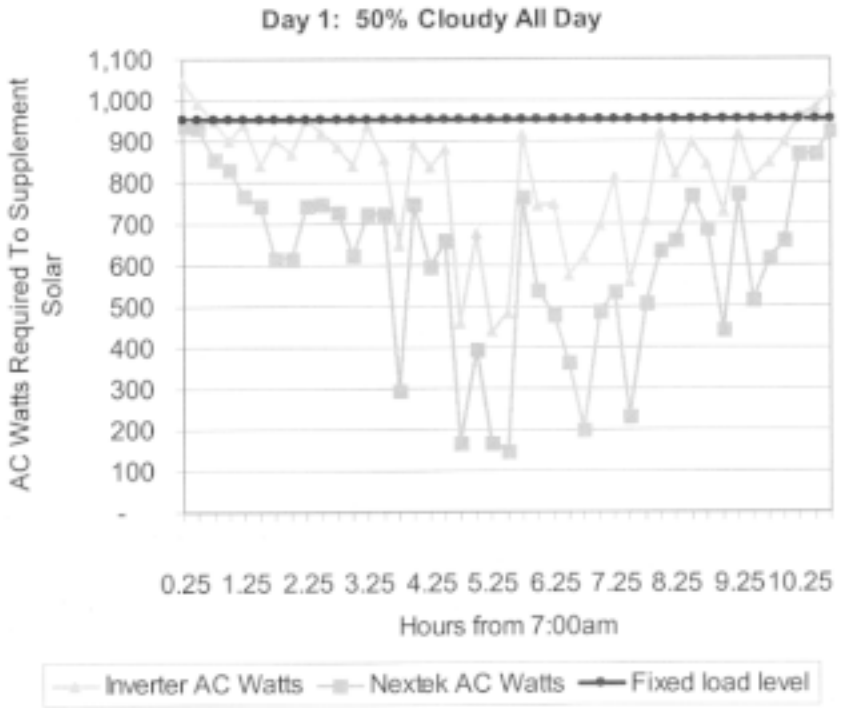


**Figure 5. Comparison of AC Watts Required to Supplement Solar On Cloudy Day.**

which are manufactured without the rectification section. In small quantities these are price competitive with standard ballasts, but in large volume they should be consistently cheaper because they have fewer parts. The inverter-based system produces AC that blends with the grid-delivered AC to service the loads in the building, many of which are electronic, and therefore are DC by nature. Energy is always lost due to the inherent inefficiency of inverters at the generating source and again by the rectifiers at the load. In conditions of lower solar irradiation such as very cloudy days, the early morning and late afternoon there is not enough solar electricity produced to operate an inverter and the solar power is totally wasted.

This is the advantage of Direct Coupling®: directly connecting the photovoltaic DC source to the building lighting load. With the Nextek system, available PV power is delivered directly to the load with unprec-

edented efficiency (~98%); with any remaining power requirement supplemented by the Nextek power module's high efficiency AC to DC converter. Solar energy and building AC are continuously blended to provide a highly regulated power source to the load. By eliminating the need for an inverter the Nextek approach dramatically reduces intervening losses when the sun is shining and in conditions of lower solar irradiation the solar power is still fully utilized.

## THE CALCULATION

There are several important variables that affected the outcome of this demonstration, as described in Table 1. First, the test was conducted in Long Island, NY, where the electricity rates are high compared to most of the country. This relatively high avoided cost supports the premise that solar is economical because more money is saved when the alternative is more expensive. Also, it is assumed that the load is operating seven days a week, during peak hours. This is also important because the panels are an expensive asset and they need to be working as much as possible to increase the capacity throughput. Economics will favor assets that are producing value all or most of the time versus those infrequently working. Also important is the size of the systems. One can expect certain economies of scale that would improve the inverter-based system's performance in large installations.

These calculations, the results of which are illustrated in Figure 6, do not include the subjective, but real effects of tax benefits such as accelerated depreciation and special treatment that may vary by state. Also, the time value of money isn't considered in the return calculation. The very real benefit of having a cap, or limit, on the price of peak power consumed over the life of the system is also not quantified, but it is real. These embedded realities, like the environmental impact that using solar has, mean different things to different people, and so have been separated from this technical exposition.

## THE IMPLICATION FOR DEVELOPING ECONOMIES

Many people in developing countries have encountered the rural use of solar, which is invariably a crude form of Direct Coupling®, usually involving batteries, a light bulb and a radio. "Crude" because these

*Learn specific steps you can take to protect your infrastructure against cyber-based attacks...*

# CYBER TERRORISM: A GUIDE FOR FACILITY MANAGERS

NEW




*By Joseph F. Gustin*

In the current climate of terrorism, the facility manager is in a more critical position than ever before. Protecting the organization's infrastructure from cyber-based attacks that are designed to disrupt and/or destroy business operations is becoming increasingly important for facility managers. This book will address cyber terrorism and other forms of terrorist activity, including mailroom security, bomb threats, and the constant attack from viruses, hackers and other invasive programs. Also covered in detail are the necessary steps for prevention, how to assess vulnerability, emergency preparedness, prevention strategies, and incident response and recovery.

ISBN: 0-88173-442-X

**ORDER CODE: 0516**

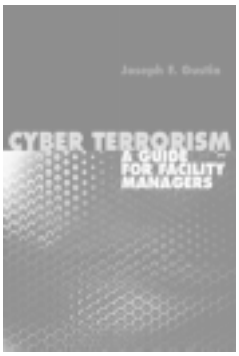*6 x 9, 247 pp., Illus.*
*Hardcover, $98.00*

## CONTENTS

1 – Technology & the Facility Manager
2 – Computer & Data Protection: The Cyber Dimension
3 – Computer & Data Protection: The Physical Dimension
4 – Business Continuity: Loss Prevention Strategies
5 – Personal User Issues
6 – Standby Power Systems
7 – Web Sites: The Cornerstone of E-Commerce
8 – Communications & Training
9 – Recovery Planning
10 – Cyber Crime: Handling the Threat
Appendices, Index

# BOOK ORDER FORM

① Complete quantity and amount due for each book you wish to order:

| Quantity | Book Title | Order Code | Price | Amount Due |
|---|---|---|---|---|
| | **Cyber Terrorism: A Guide for Facility Managers** | **0516** | **$98.00** | |
| | | | Applicable Discount | |
| | | | *Georgia Residents add 6% Sales Tax* | |
| | | | Shipping Fees | 9.00 |
| | | | TOTAL | |

② Indicate shipping address: **CODE: Journal 2003**

NAME (Please print) BUSINESS PHONE

SIGNATURE (Required to process order)

COMPANY

STREET ADDRESS ONLY (No P.O. Box)

CITY, STATE, ZIP

③ Select method of payment:

☐ **CHECK ENCLOSED**

☐ **CHARGE TO MY CREDIT CARD**

☐ *VISA* ☐ *MASTERCARD* ☐ *AMERICAN EXPRESS*

CARD NO.

*Expiration date* *Signature*

*Make check payable in U.S. funds to:* **AEE ENERGY BOOKS**

**MEMBER DISCOUNTS**
A 15% discount is allowed to AEE members.
☐ AEE Member (Member No._____)

Send your order to:
**AEE BOOKS**
P.O. Box 1026
Lilburn, GA 30048

INTERNET ORDERING
www.aeecenter.org

TO ORDER BY PHONE
**Use your credit card and call :**
(770) 925-9558

TO ORDER BY FAX
**Complete and Fax to:**
(770) 381-9865

**INTERNATIONAL ORDERS**
Must be prepaid in U.S. dollars and must include an additional charge of $10.00 per book plus 15% for shipping and handling by surface mail.

*Your complete guide to assuring high quality indoor air in your facility...*

# INDOOR AIR QUALITY: A GUIDE FOR FACILITY MANAGERS

**BRAND NEW EDITION**




SECOND EDITION

*By Ed Bas*

Indoor air quality has been both much debated and much feared in recent years. This guide provides a comprehensive account of indoor air quality hazards, their sources, and appropriate solutions. Written in easy-to-understand, non-technical terms, it is designed to be used as both a ready reference and training guide for managers of all types of facilities. Each specific type of indoor air hazard is addressed, including allergens, asbestos, formaldehyde and VOCs, radon, tobacco smoke, legionellosis and related illnesses, carbon monoxide, multiple chemical sensitivity, and toxic mold. The basics of proper ventilation and the relationship of the HVAC system to indoor air quality are fully explained. Fundamental procedures for maintaining good air quality, including filtration, control of humidity and moisture, and duct cleaning are examined in detail. A full chapter is devoted to recent developments and procedures for controlling toxic mold. Case studies, an HVAC glossary, and several helpful directories are also included.

ISBN: 0-88173-327-X

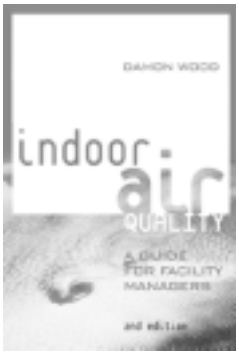**ORDER CODE: 0523**

*6 x 9, 386 pp., Illus.*
*Hardcover, $92.00*

## CONTENTS

1 – Introduction to Sick Buildings
2 – IAQ Hazards to Human Health & Productivity
3 – HVAC Basics & Indoor Air Quality
4 – Improving Ventilation
5 – Improving Filtration: Recycling Air
6 – Controlling Humidity & Moisture
7 – The Value of Duct Cleaning
8 – Putting It All Together: The IAQ Program
9 – Mold: Potential Threats Sprout in a Watery World
Appendices
Index

# BOOK ORDER FORM

① Complete quantity and amount due for each book you wish to order:

| Quantity | Book Title | Order Code | Price | Amount Due |
|---|---|---|---|---|
| | **Indoor Air Quality: A Guide for Facility Managers, Second Edition** | **0523** | **$92.00** | |

② Indicate shipping address: **CODE: Journal 2003**

NAME (Please print) BUSINESS PHONE

SIGNATURE (Required to process order)

COMPANY

STREET ADDRESS ONLY (No P.O. Box)

CITY, STATE, ZIP

| | |
|---|---|
| Applicable Discount | |
| *Georgia Residents add 6% Sales Tax* | |
| Shipping Fees | 9.00 |
| TOTAL | |

**MEMBER DISCOUNTS**
A 15% discount is allowed to AEE members.
☐ AEE Member (Member No._____)

③ Select method of payment:
☐ **CHECK ENCLOSED**
☐ **CHARGE TO MY CREDIT CARD**
☐ *VISA* ☐ *MASTERCARD* ☐ *AMERICAN EXPRESS*

CARD NO.

*Expiration date* *Signature*

*Make check payable in U.S. funds to:*
**AEE ENERGY BOOKS**

Send your order to:
**AEE BOOKS**
P.O. Box 1026
Lilburn, GA 30048

INTERNET ORDERING
www.aeecenter.org

TO ORDER BY PHONE
**Use your credit card and call:**
(770) 925-9558

TO ORDER BY FAX
**Complete and Fax to:**
(770) 381-9865

**INTERNATIONAL ORDERS**
Must be prepaid in U.S. dollars and must include an additional charge of $10.00 per book plus 15% for shipping and handling by surface mail.

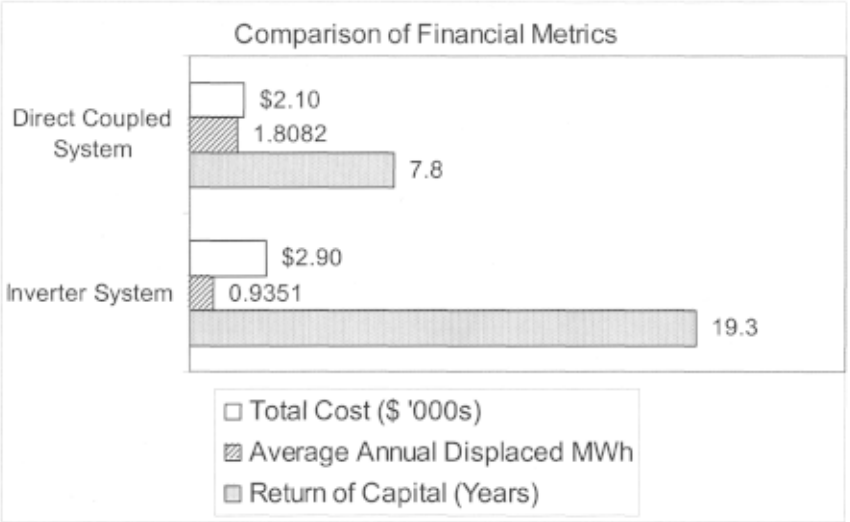


**Figure 6. Financial Metrics to Illustrate Direct Coupling® Advantage.**

**Table 1. Assumptions used in 900-Watt peak system**

| *Key Assumptions* | *Inverter System* | *Direct Coupled System* |
|---|---|---|
| Cost of solar @ $6.50/W installed | $5,850 | $5,850 |
| Retail cost of interface of 1 kW | $1,100 | $500 |
| 3-hrs labor @ $85 | $255 | $255 |
| System rebate of $5/W | -$4,500 | -$4,500 |
| Avoided cost per kWh | $0.15 | $0.15 |
| Days per year operating | 365 | 365 |

systems are not tuned to take advantage of what the DC world has to offer: the battery is usually a car-type designed for high-power, not deep cycles; the light-bulb is low wattage, and the radio is necessarily near-by because the 12-volt DC can't get very far due to excessive losses in the wire. The essence is there, but the elegance is absent. A very small investment can upgrade this arrangement through better engineering.

The power module has three ports for input: DC, AC and storage

(also DC). These three commingle to produce one very tightly regulated DC output. Inherent in the power module's design is battery management, which is very much needed to optimize the storage medium's life. Also regulation is very important, because if there is a common AC source available, or generated, it will be subjected to great spikes and frequent brownout conditions.

This arrangement can deliver a far higher quality system to the world's communities that need it the most, and the range of loads is not paltry: lights, radios, computers, fans and phones.

## CONCLUSION

While the cost of Solar PV continues to decline, it remains dependent upon government incentives to be cost effective. In time, as materials get cheaper in volume and systems become more modularized, the cost benefit analysis will become more attractive. By providing a more pre-engineered solution, this multi-source power module will cut the cost of design and installation dramatically. By reducing the number of parts, reliability will also increase. We believe that Direct Coupling® will always deliver significantly more energy to predictable loads than traditional methods can, not counting the benefit of a having a port that automatically and seamlessly manages the storage of electricity. Therefore, Direct Coupling® is the logical choice of topology for this source of electricity and DC loads that can be married to it.

---

ABOUT THE AUTHOR

**Paul Savage** is the CEO of Nextek Power Systems, Inc., a manufacturer and developer of DC power networks in Long Island, NY. His prior experience includes investment banking for development-stage companies, and fixed-income trading at CS First Boston Corporation. He also had responsibility for over $1 billion in credit risk management and portfolio hedging at Lehman Brothers. In 1995, he spent 2 years in Hanoi, Vietnam to start-up operations for V-Trac, a partnership with Caterpillar Inc. Mr. Savage is an outside Director of Red-Horse Securities, the first Native-American owned and operated Broker/Dealer in the United States. He is a graduate of Haverford College and speaks German and Vietnamese. He may be reached at benh@nextekpower.com.